



NOTES:
NO VOLTAGE ABOVE 24V SHOULD BE PUT INTO THE NC TERMINALS

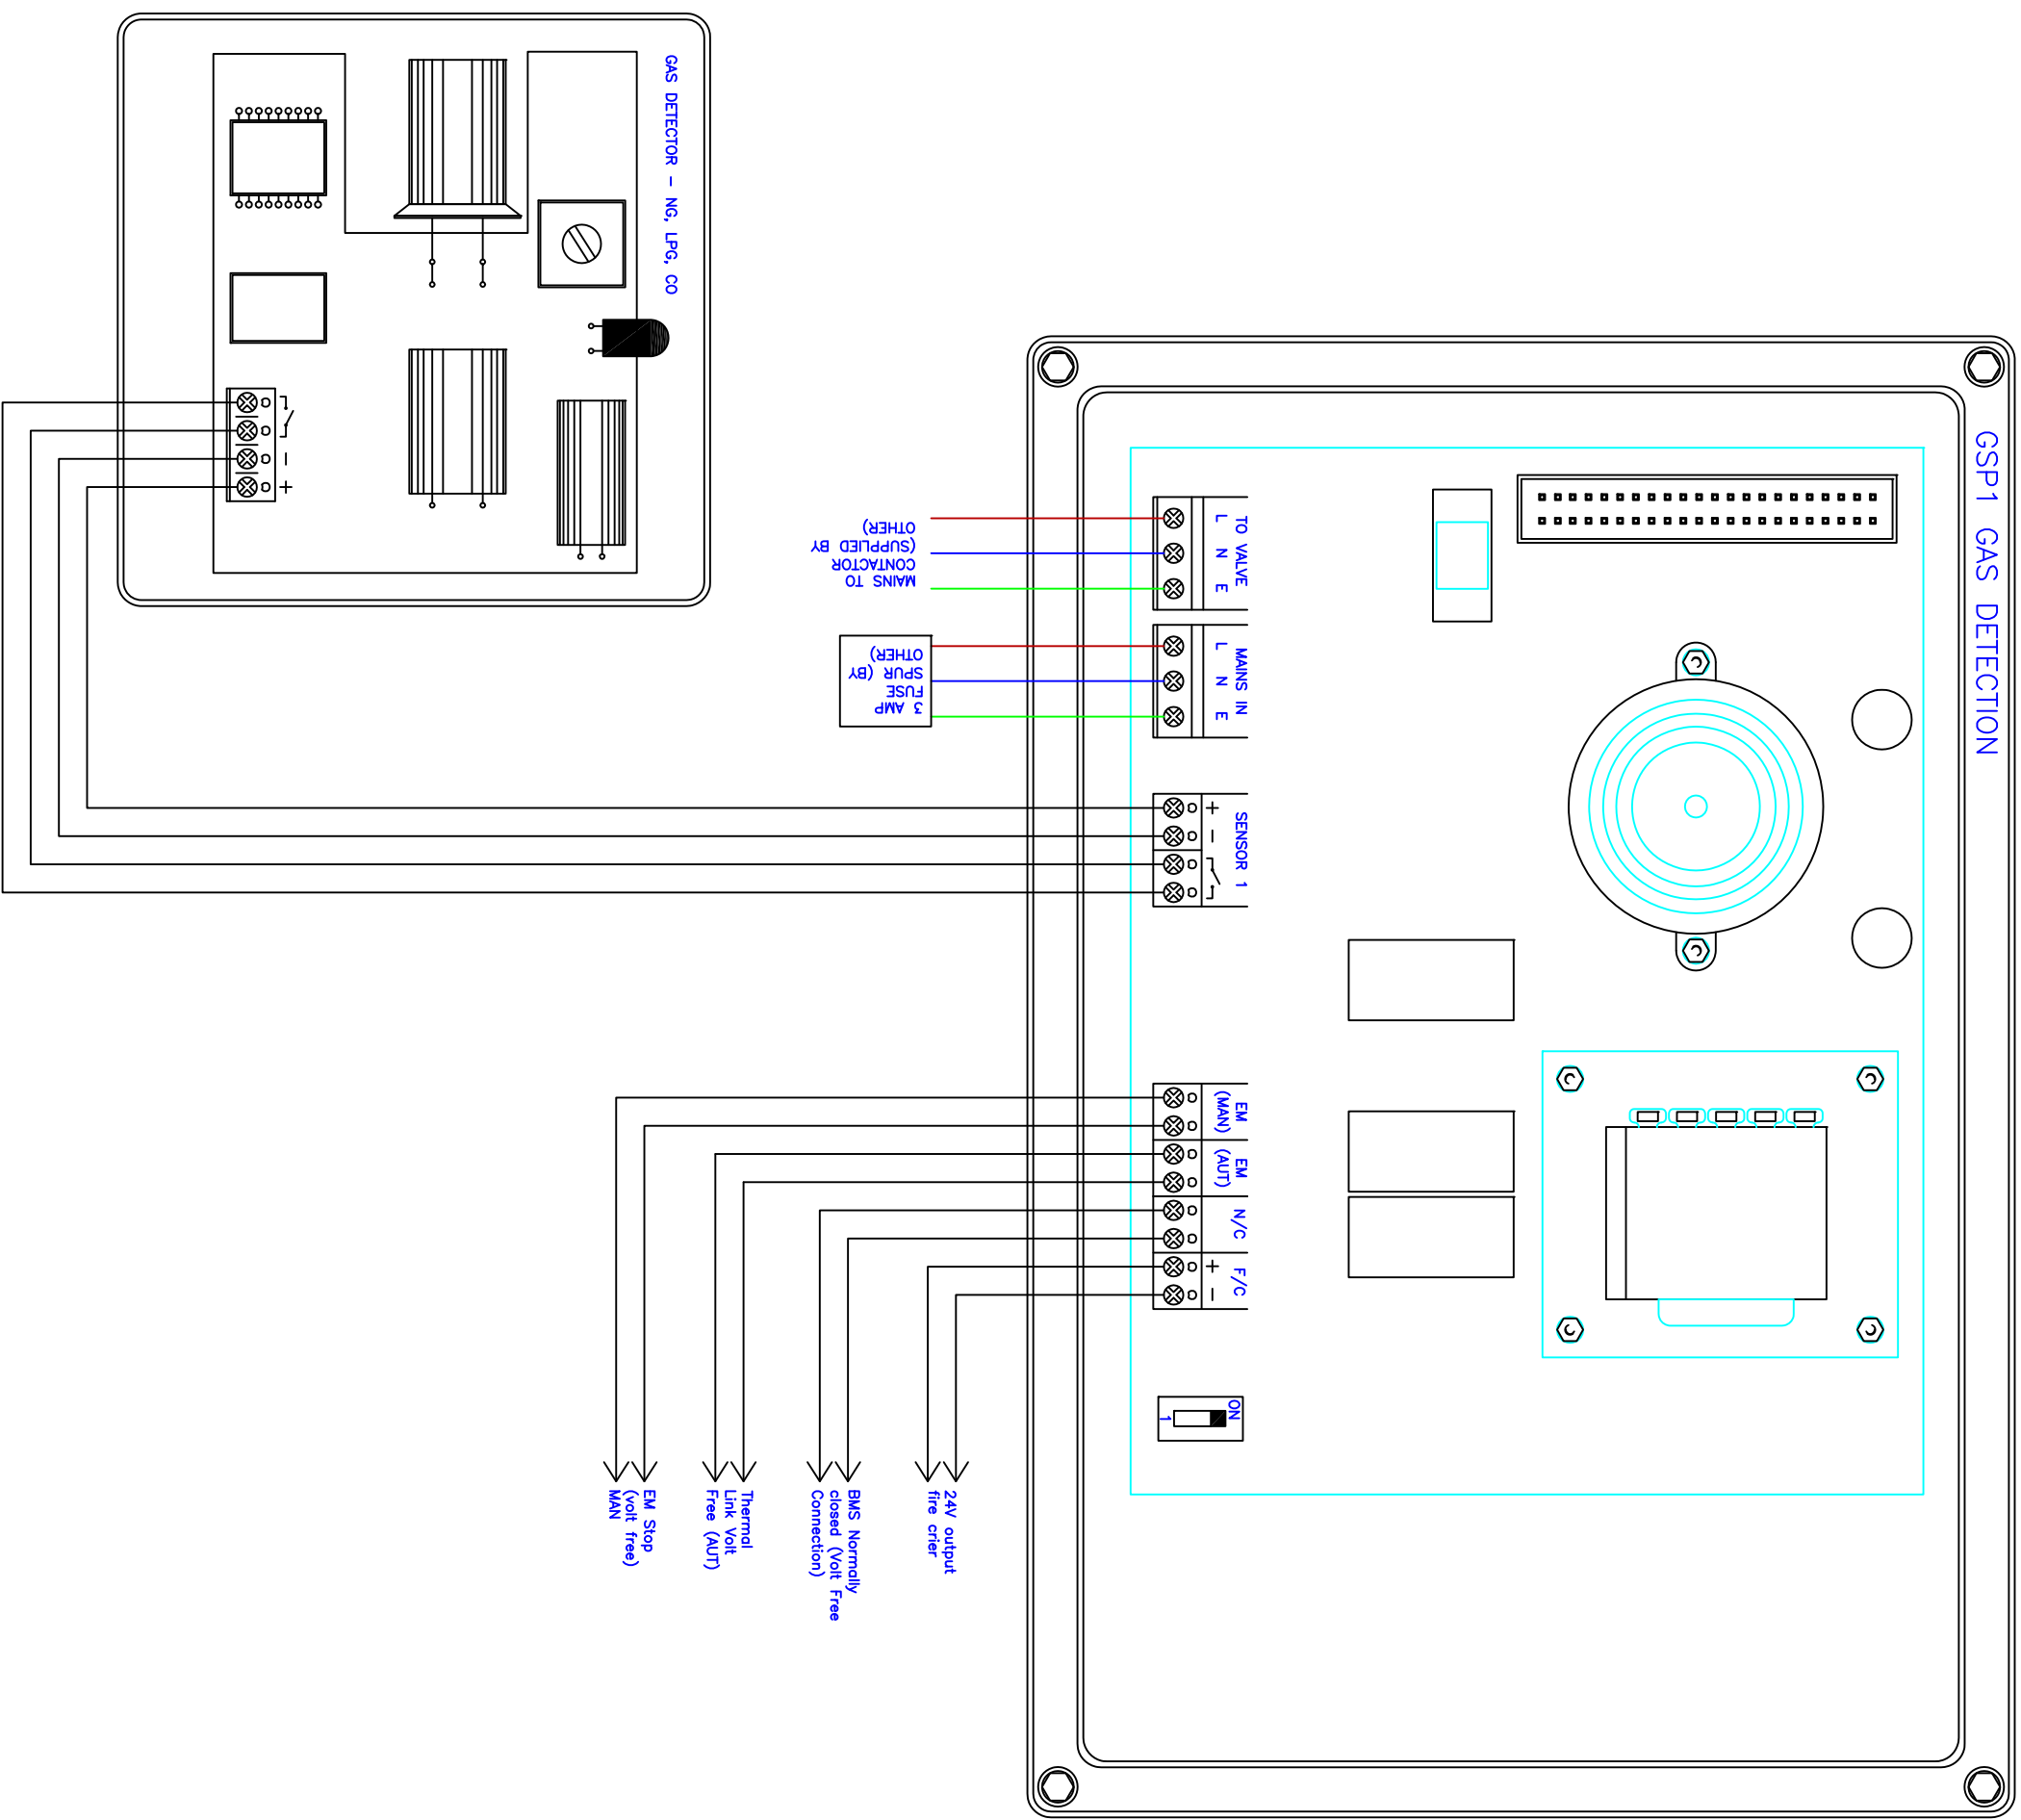

Rev.	Drawn	Chkd.	Approved	Date	Description
-	C	C	C	C	PRELIMINARY

Project: **SNS**
NORTHERN

Drawing Title
GSP1 GAS
DIAGRAM



 www.snsnorthern.com
 Unit 2, Debraux Industrial Estate, Moss Lane, Coppull, Chorley, PR7 5AL
 Tel: 01257 470 863 Fax: 01257 471 907 Email: info@snsnorthern.com
 Scale (at A1) **11/11** Date **11/11** Drawn **SLB** NOT TO SCALE
 Job no. **JOB-DWG-NO** Rev. no. **-**