
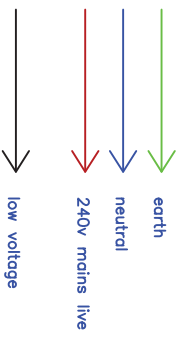


NOTES:
NO VOLTAGE ABOVE 24V SHOULD BE PUT INTO THE NC TERMINALS

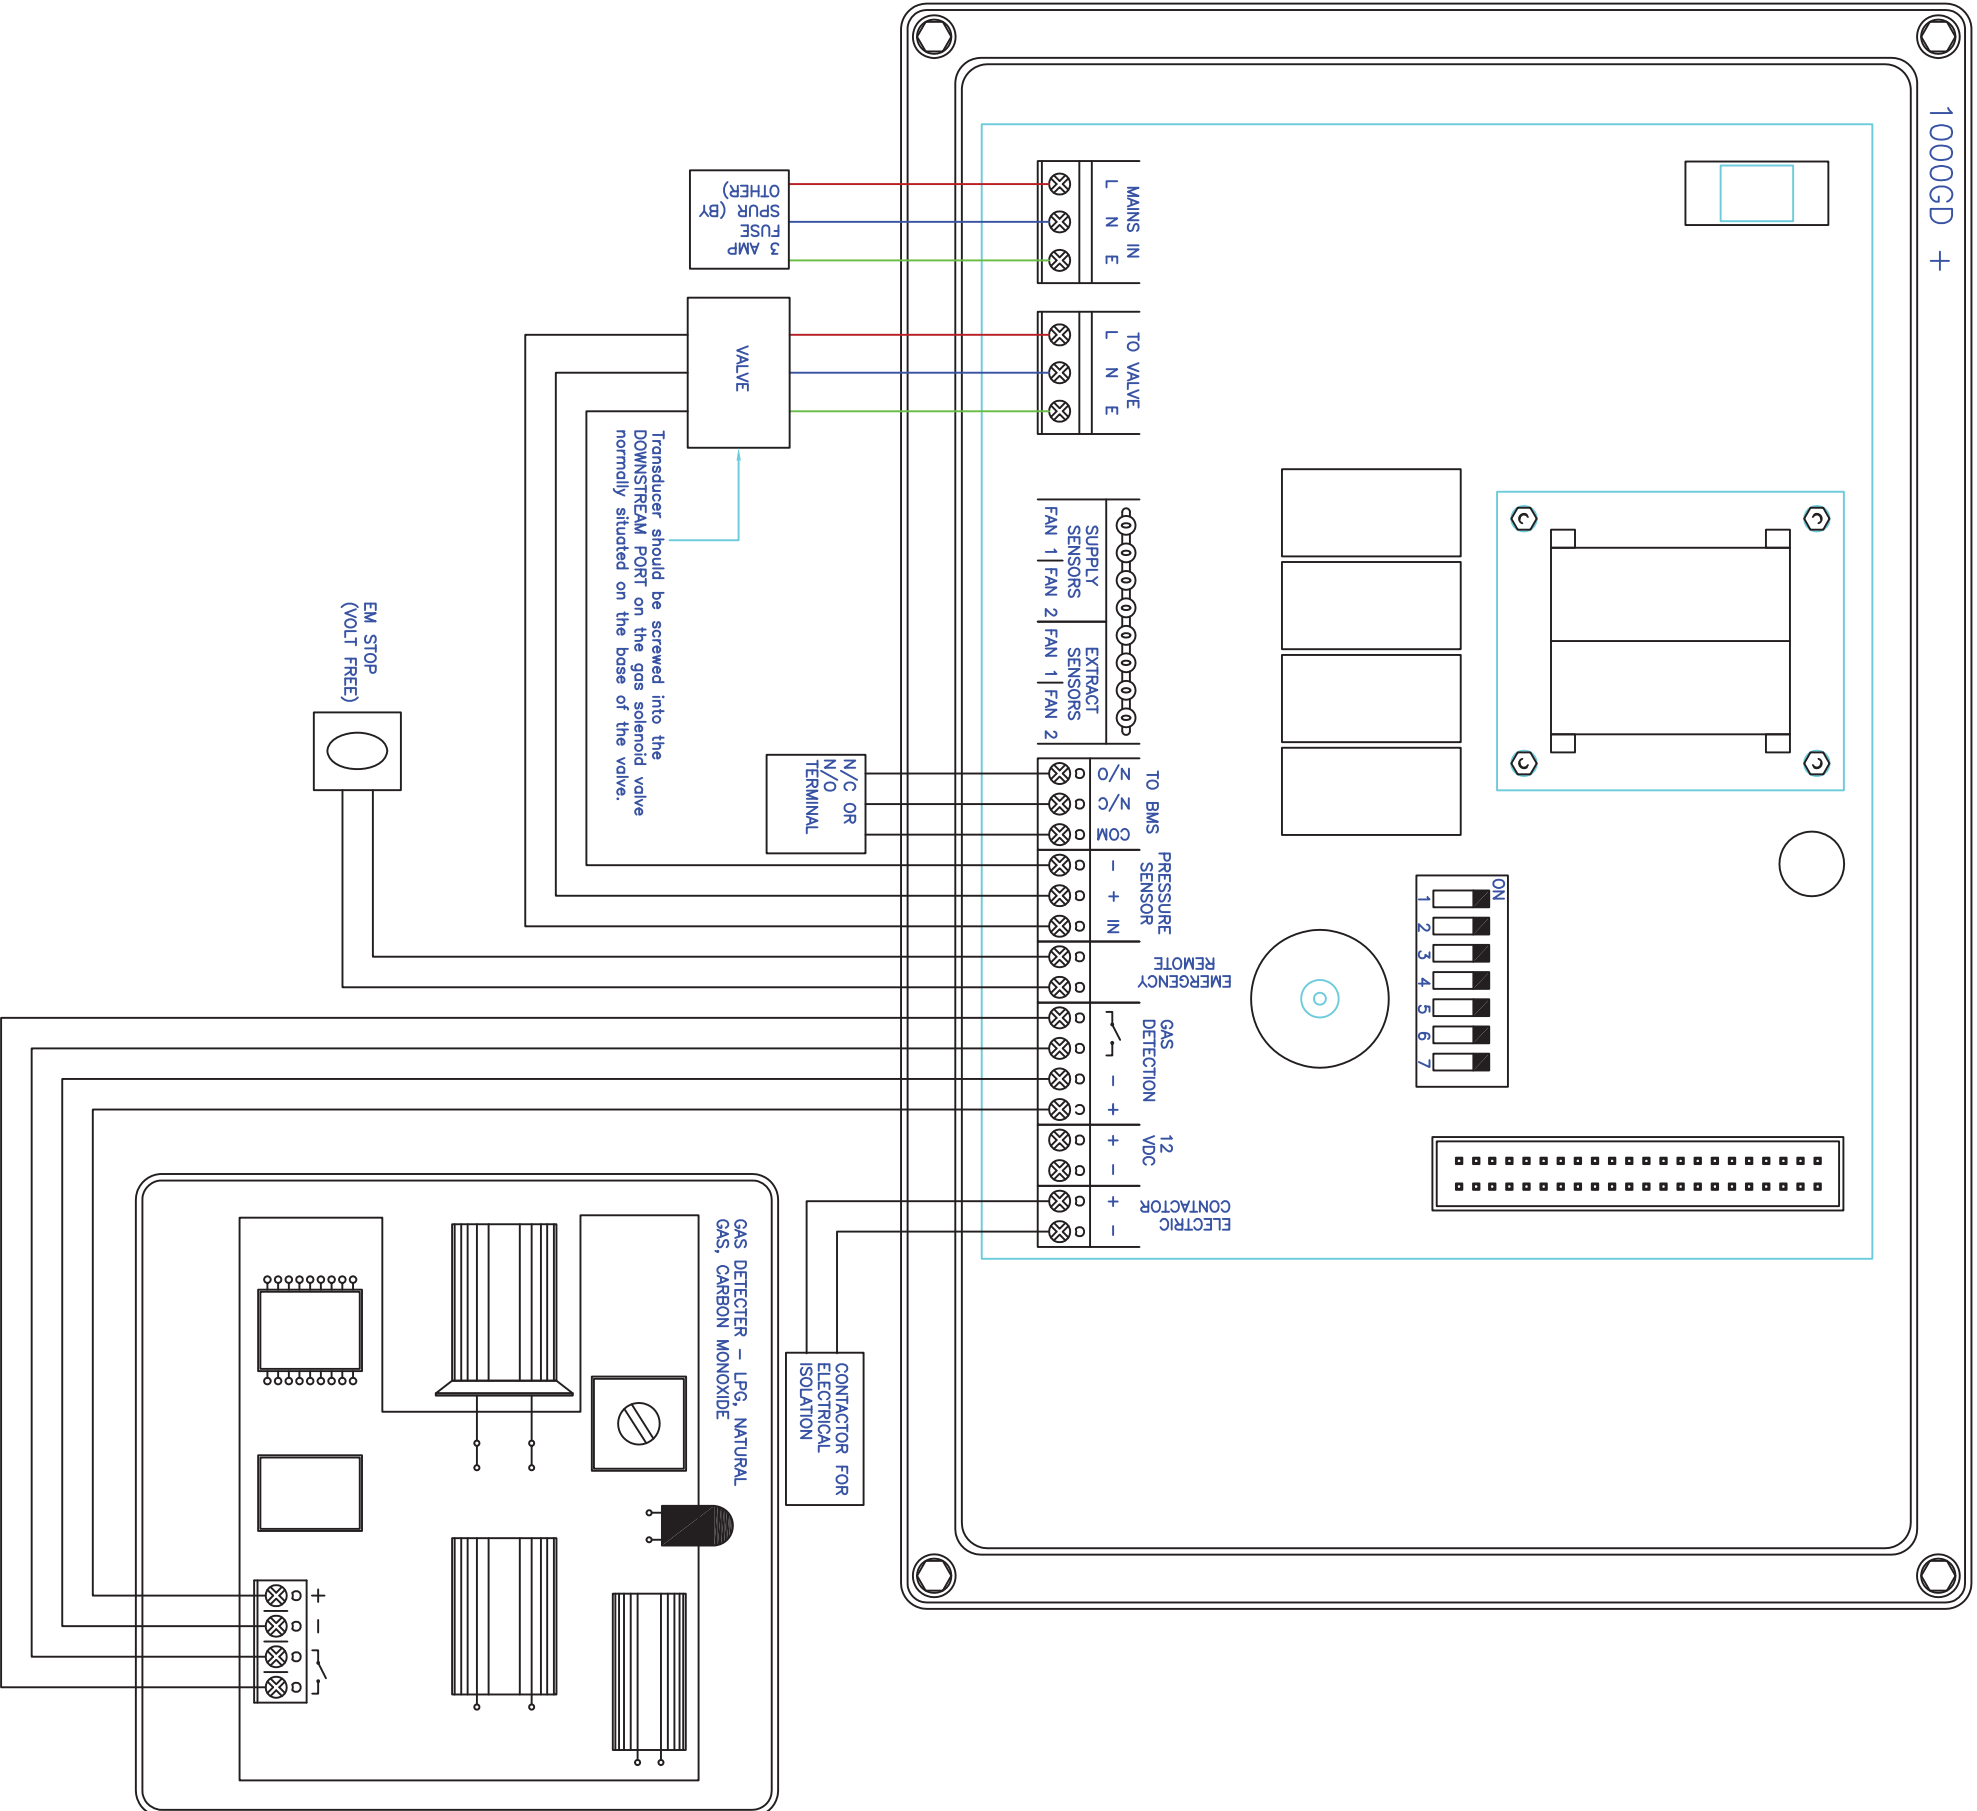

Rev.	Drawn	Chkd.	Apprvd.	Date	Description
1	C	C	C	C	PRELIMINARY

Project: SNS
NORTHERN

Drawing Title
CT1000GD+
DIAGRAM



Scale (at A1)
NOT TO SCALE
Date: 11/11
Drawn: SLB
Job no.: JOB-DWG-NO